

Supply Of / Three Phase Motor (590kw) For Crushing Plant

The southern cement state company is pleased to announce the tender mentioned herewith below, and in that regard if any of the suppliers wishes to participate , please do not hesitate to attend to the commercial department at the company main office located in Kufa-Iraq , in order to obtain a copy of the tender paper which includes the specifications required , the charge for tender paper will be (100,000 ID) , this amount is un returnable, or they can view the tender paper through our website (www.southern-cement.com) , (www.industry.gov.iq) Note that the closing date is On Monday 17 /11/2014 at 12:00 noon , which is the latest date to receive any offer, after which no offer would be accepted. The estimated price to this tender is(120,000 \$) (One Hundred twenty Thousand Dollars) Offers should be presented to the company main office exclusively and incase the closing date was considered to be a holiday the date will be shifted to the next day. The company or bureau that wishes to participate should present the offer in three different envelopes, the first is the commercial offer, the second is the technical offer, and the third contains the documents required for participation which is mentioned below, the bid bond should be enclosed in the commercial offer exclusively, which should be amounted to represent 1% of the total value of the estimated price, in the form of a certified check issued from a governmental bank in Iraqi dinar or a bank letter of guarantee from Iraqi accredited bank, that is extendable automatically with a document certifies issuing of the bank guarantee, and solely, and should state that the guarantee is valid and not to be released unless the guarantee in no longer required through a notification issued by our company to the bank that issued the bond, and through a formal channel by a validity letter signed by the bank through the bank manager or the authorized signatory to certify the issuance of such guarantee moreover the envelopes should be closed and sealed and bears the title of the envelop (commercial, technical, and documents) with the number of tender, and the closing date, name of company, and name of authorized person, however offer should include the following, otherwise would be neglected :

1. The company should be experienced and has the specialty required to carryout such jobs, and also a certificate of good performance for executing pervious jobs, which should be presented.
2. A letter of presentation of the company should be presented. with a letter of authorization of the recipient valid for this year.
3. A copy of the internal system of the company and name of founders with a copy of foundation contract.
4. The representative of Arabic or foreign company must submit a permit to practice commercial agency according to laws and regulations, and must be authentic and certified by the related officials valid for this year.
5. Original copy of the tender paper receipt.

6. The technical offer must include the company or bureau address and e mail and all telephone number and also with documents presented with stating the authorized signatory.
7. The company financial state certificate (annual reports for the last three years).

Further more it should be noted the whoever is awarded the tender will bear the announcement fees.

The annunciation:

24A/T/SOC-1/2014 : Supply Of / Three Phase Motor (590kw) For Crushing Plant

General Director

تجهيز محرك الكسارة ذو القدرة (590kw) / معمل سمنت الكوفة

يسر الشركة العامة للسمنت الجنوبية إحدى تشكيلات وزارة الصناعة والمعادن إعلان المناقصة المدرجة في أدناه فعلى الراغبين بالاشتراك من الشركات والمكاتب التجارية المتخصصة مراجعة الدائرة التجارية في مقر الشركة الكائن في الكوفة /محافظة النجف للحصول على نسخة من المواصفات الفنية و الشروط المطلوبة لقاء مبلغ (١٠٠,٠٠٠ دينار) للمناقصة غير قابلة للرد.أو الإطلاع عليها من خلال موقعنا على الانترنت وهو www.southern-cement.com وموقع الوزارة www.industry.gov.iq علما إن آخر موعد لتقديم العروض سيكون خلال الدوام الرسمي ليوم الاثنين المصادف ٢٠١٤/١١/١٧ لغاية الساعة الثانية عشر ظهرا في مقر الشركة حصرا وفي حالة مصادفة يوم الغلق عطلة رسمية يكون اليوم الذي يليه هو يوم الغلق. علما إن السعر التخميني للطلبية ١٢٠,٠٠٠ دولار (مائة وعشرون ألف دولار) وعلى الشركة أو المكتب تقديم ثلاثة ظروف احدهما فني والثاني تجاري والثالث يحتوي على مستمسكات الشركة المطلوبة والمدرجة في أدناه وعلى أن يرفق مع العرض التجاري حصرا التأمينات الأولية البالغة ١% من قيمة السعر التخميني بصك مصدق من مصرف حكومي بالدينار العراقي أو خطاب ضمان صادر من مصرف عراقي معتمد قابل للتجديد تلقائيا ومشروط بعدم الإطلاق ألا بإشعار من قبل شركتنا وتكون صادرة من المحافظات (بغداد ، بابل، كربلاء ، النجف، الديوانية، المثنى، ذي قار، الكوت، ميسان ، البصرة) حصرا" وبكتاب رسمي صادر من المصرف المختص وبتوقيع المدير العام أو المدير المفوض أو من ينوب عنهما يؤيد فيه صحة صدور الخطاب وان تكون الظروف مغلقة ومختومة ويثبت عليها عنوان الظرف (تجاري ، فني ، مستمسكات الشركة) مع رقم المناقصة وتاريخ الغلق واسم الشركة و اسم المخول وسيعتبر أي عطاء غير مستوفي للشروط التالية مهمل ما لم يرفق بما يلي:-

- ١- أن تكون الشركة لديها الخبرة والاختصاص ولها صفقات حصلت بها على شهادة حسن التنفيذ مع تقديم ما يثبت ذلك.
- ٢- أن يقدم تعريفا بالشركة مع كتاب تخويل للمخول بتقديم العطاء مصدق ونافذ لهذا العام .
- ٣- أن يقدم شهادة تسجيل الشركة لدى وزارة التجارة مصورة نافذة لهذا العام للشركات العراقية.
- ٤- أن يقدم كتاب عدم الممانعة من الهيئة العامة للضرائب بالاشتراك بالمناقصات نافذ لهذا العام للشركات العراقية.
- ٥- أن يقدم كتاب براءة الذمة من الهيئة العامة للضرائب نافذ لهذا العام للشركات العراقية.
- ٦- أن يقدم صورة من النظام الداخلي للشركة وأسماء المؤسسين لها مع صورة من عقد التأسيس.
- ٧- على ممثل الشركة العربية أو الأجنبية أن يقدم أجازة ممارسة أعمال الوكالة التجارية المنصوص عليها في القانون وتكون مصدقة من الجهات المعنية نافذة لهذا العام .
- ٨- في حالة كون المجهز مكتب تجاري فيتم تقديم صورة من هوية الانتساب لأحدى الغرف التجارية في القطر ومجددة لهذا العام
- ٩- يرفق وصل شراء التندر (نسخة أصلية)
- ١٠- أن يتم تثبيت عنوان الشركة المتقدمة أو المكتب التجاري أو مخول الشركة العربية أو الأجنبية داخل العراق وبشكل دقيق مع ذكر البريد الالكتروني وكافة أرقام الهواتف في العرض الفني والمستمسكات مع ذكر أسماء المخولين بالتوقيع.
- ١١- تقديم هوية اتحاد رجال الأعمال العراقية نافذة لهذا العام للشركات العراقية.
- ١٢- تقديم وثيقة الوضع المالي للشركة المتقدمة (التقرير السنوي للسنوات الثلاثة الأخيرة) ..
- ١٣- على كافة الشركات والمكاتب والمقاولين تقديم ما يثبت حجب البطاقة التموينية عنهم ممن يشملهم الحجب قبل تمشية معاملاتهم للشركات العراقية.
- ١٤- ويتحمل من ترسو عليه المناقصة أجور نشر الإعلان

...مع التقدير

المناقصة: ٢٠١٤/م/س ج ن-١/٢٤ تجهيز محرك الكسارة ذو القدرة (590kw) / معمل سمنت الكوفة

المدير العام

نسب ترجيح المناقصة المرقمة (١٢٤/م/س ج ن-٢٠١٤)
تجهيز محرك الكسارة 590 KW / معمل سمنت الكوفة
Differentiation ratios of tender No (24 A/T/SOC-1/2014)

المعايير	
المواصفات الفنية Technical Specifications	1__5 %
قائمة بالأعمال المماثلة مؤيدة من الجهات المتعاقد معها Similar Works Issued And Approved By The Concerned Authorities	2%
فترة التجهيز Delivery Period	1__10%
منشأ المواد Good fabricator (manufacturer)	• 1-20% For Germany, Sweden, France, England, Finland,USA • ١- ٢٠% منشأ ألمانيا ، السويد، فرنسا، انكلترا، فنلندا، أمريكا • 1-10% for Italy, Romania , Spain, Hungary • ١- ١٠% منشأ إيطاليا، رومانيا، اسبانيا ، هنغاريا. • Any origin otherwise what had been mentioned above will be neglected • يكون تجهيز المادة من المنشأ المذكورة أعلاه حصراً وبخلافه يهمل العرض
السعر (Price)	1__63%

ماجد عباس عيد
مدير الصيانة المركزية
رئيس اللجنة

نبيل عباس علي
مدير التخطيط والرقابة على الإنتاج
عضو

وهب عباس عيد النبي
مدير التجاري
عضو

مالك صاحب جودة
مدير الرقابة الداخلية
عضو

مصادقة السيد المدير العام المحترم:

موافق

٢٠١٤

Southern cement state company
Kufa cement plant
QM-F-13-2


Item. No.	Specification	Qty.
1.	3- phase squirrel cage induction motor for crushing plant with capacitor set to improve power factor to 0.95 Power = 590 kw , speed= 992 r.p.m , frequency = 50 Hz, Y- connection - Stator voltage = 6600 v - Stator current = 63 Amp. - Ins .class/ Temp.rise = H / 70 K - Ambient .temp. = 50 C° - IC 611 , IP 54 , duty S1 - Altitude max. (1000 m) above sea level. - direction of rotation CW &CCW . - Bearing antifriction bearings grease lubrication . - Windings protection sensors (pt 100/6) two for each coil. - Bearings protection sensors (pt 100/2). <u>Spare part</u> - One set bearing (NDE-DE). - Maintenance electrical & mechanical document (English language) - The dimension as attached drawing. - Warranty (12 months). - Training for three electrical engineers in manufacture workshop.	1

LA CI
1/1/11
1/1/11

1/1/11
C.I./A.C.I

1/1/11
1/1/11

C.I.
1/1/11
1/1/11

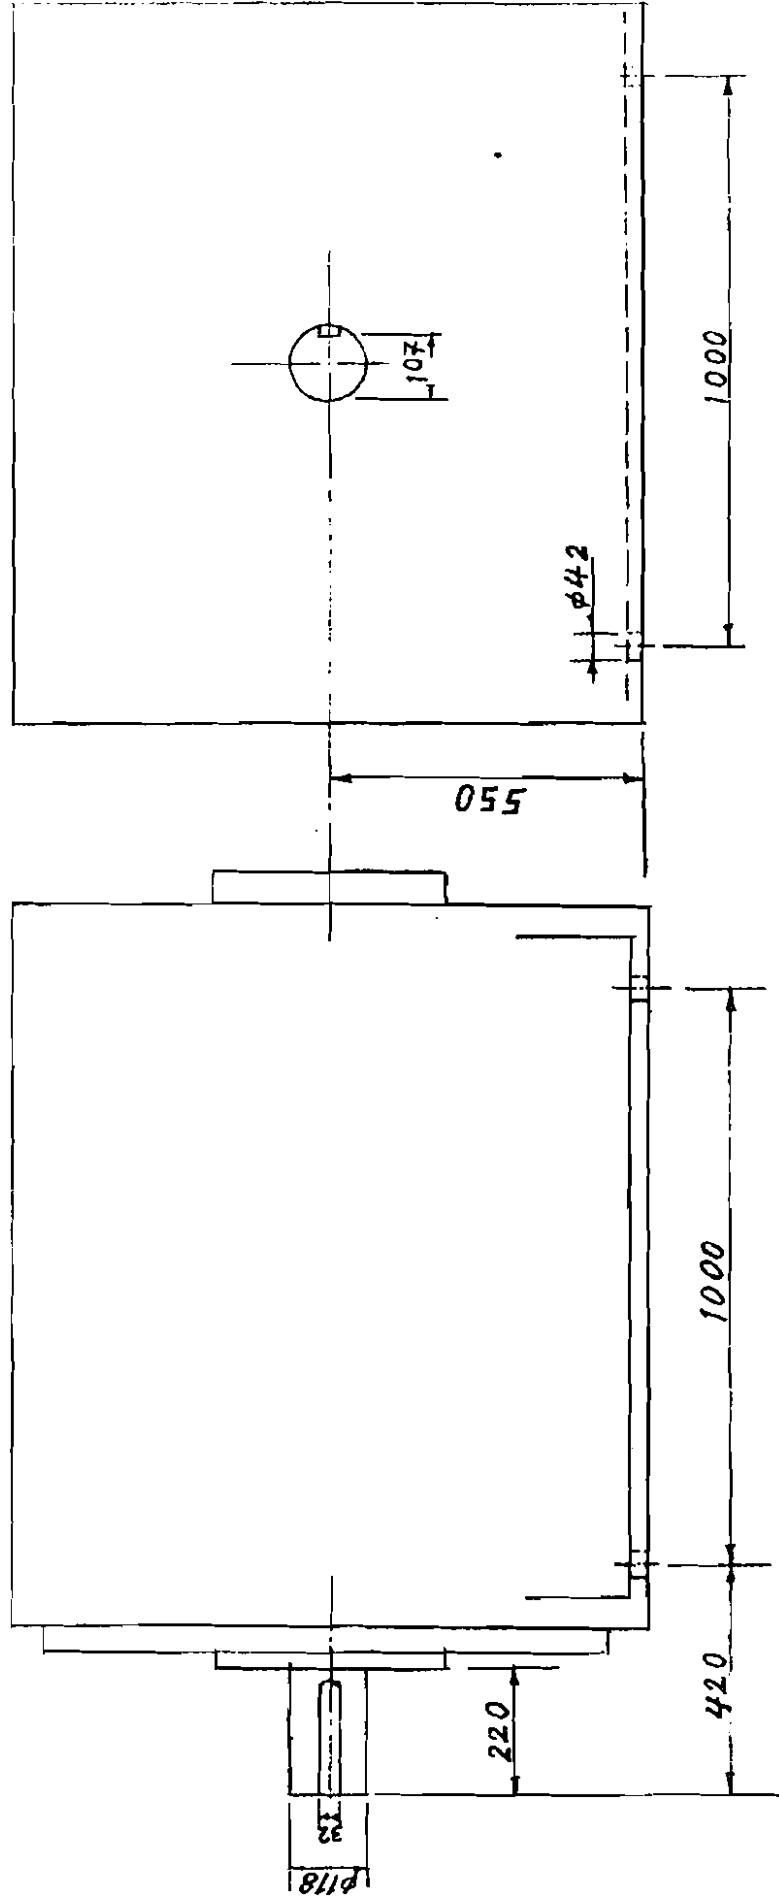

المحرك الرئيسي للكسارة

المقطع

٨ / ١١

٢٠١٤

٢٠١٤

موقع: جميع الساعات بالليل

٢٠١٤ / ٨ / ١١